
Exova Warringtonapt Key Industrial Park Fernside Road Willenhall West Midlands WV13 3YA T: +44 (0) 1902 722 122 F: +44 (0) 1902 727 242 E: willenhall@exova.com W: www.exova.com



Report No: 303286b

BS 8424 BUILDING HARDWARE-PULL HANDLES

Assessment of: Eurolever Monte Carlo Collection Ref 1300, Pull Handles (380mm Length)

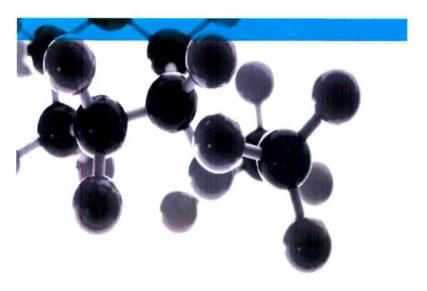

Tested to: BS8424:2004

For: Eurolever Architectural Hardware Limited 2 Charles Street London W1J 5DE

Assessment of: Eurolever Monte Carlo Collection Ref 1300, Pull Handles (380mm Length)

A Report To: Eurolever Architectural Hardware Ltd

Document Reference: 303286b





BS 8424 BUILDING HARDWARE-PULL HANDLES



TEST CONCLUSIONS

Samples of: Pull Handles

Product: Eurolever Monte Carlo Collection Ref 1300 Pull Handles Manufactured by: Eurolever Architectural Hardware Limited

Model: Ref 1300

Size: 380mm x 25mm x 75mm

have been assessed in accordance with: BS8424:2004

By Exova Warringtonapt Laboratories Ltd.

At Key Industrial Park, Fernside Rd., Willenhall,. West Midlands. WV13 3YA,

Results as detailed below:

7.3.3.2	AND THE RESIDENCE OF THE PROPERTY OF THE PROPE	
1.3.3.2	Durability handles less than 200 mm long	N/a
7.3.3.3	Durability handles more than 200 mm long	Yes
4.7	Corrosion resitance Grade 4	Yes

All results contained in this report were assessed from report number 303286

No inferences can be made regarding performance against other requirements of this standard

Document No.:

303286b

Page No.:

2 of 9 24/03/2011

Author: Client: A Fairfield Eurolever

Hardware Ltd

Architectural

Issue Date: Issue No.:

.





AUTHORISATION

Tests performed by: Alan Fairfield – Test Engir	neer	
---	------	--

Report issued by: Alan Fairfield - Test Engineer

Date 24th March 2011

For and on behalf of Exova Warringtonapt

Report authorised by: Ian Keeling - Operations Manager

Leel

Signed

Date 24th March 2011

For and on behalf of Exova Warringtonapt

Report issued: 24th March 2011



Tests marked "Not UKAS Accredited" are not covered by the Laboratory UKAS accreditation schedule.

Tests marked NT were not tested

Tests marked NA are not applicable to the product on test.

The laboratory has tested the product supplied by the client as sampled in accordance with their own requirements

0621

Exova Warringtonapt is an EC Notified Body Number 1104

This report shall not be reproduced except in full, (and then only as permitted by copyright laws), without written approval from Exova Warringtonapt

Document No.: 303286b

Page No.:

3 of 9

Author:

A Fairfield

Issue Date:

24/03/2011

Client:

Eurolever Hardware Ltd

Architectural Issue No.:

1

